


TOP VIEW

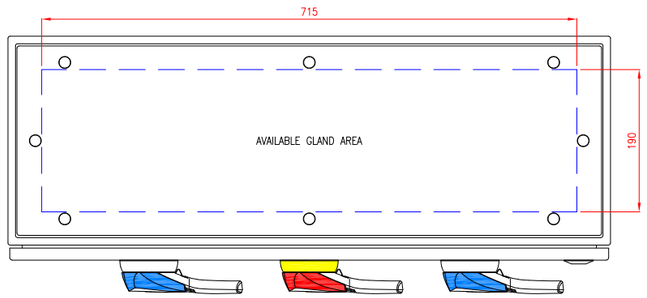


SIDE VIEW

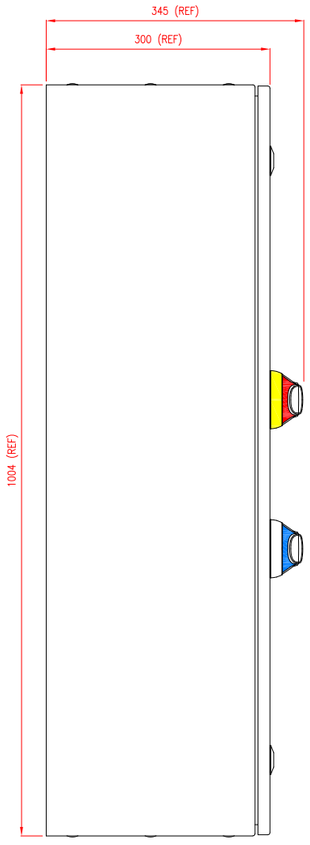


FRONT VIEW

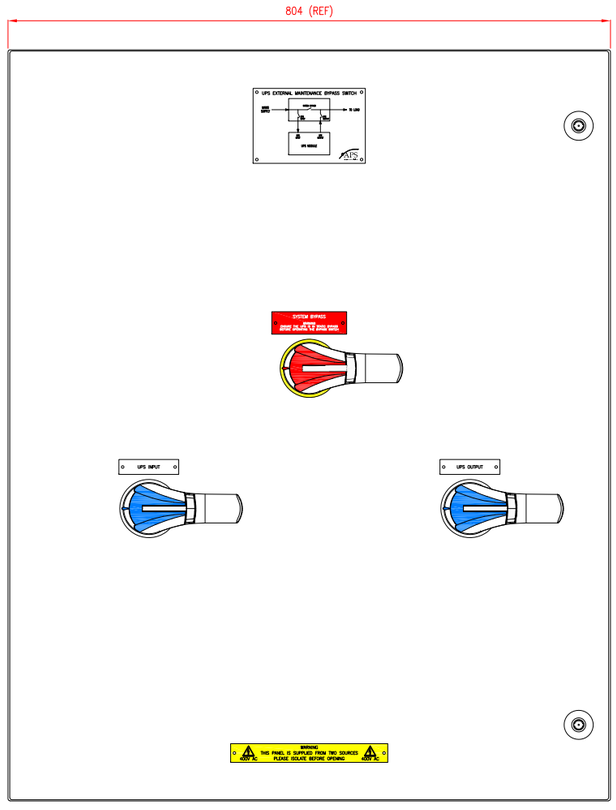

INTERNAL VIEW

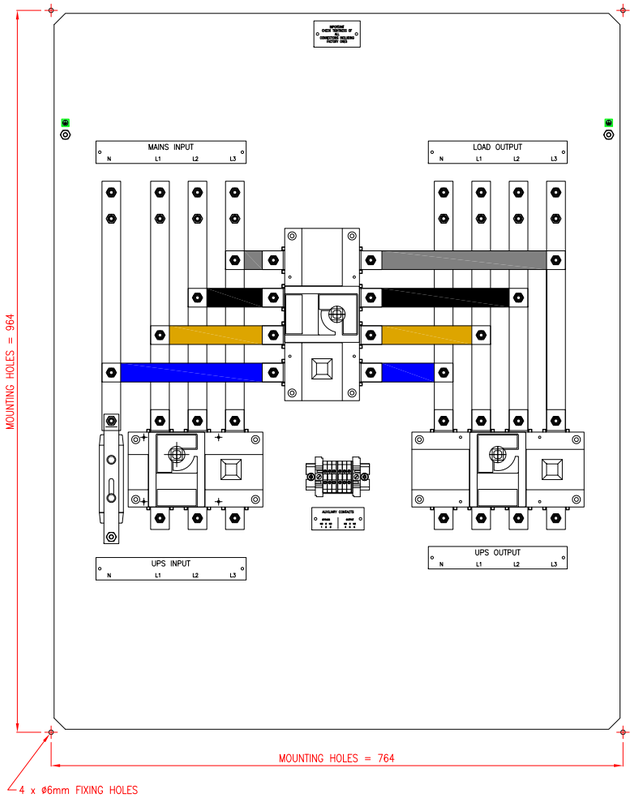

BOTTOM VIEW

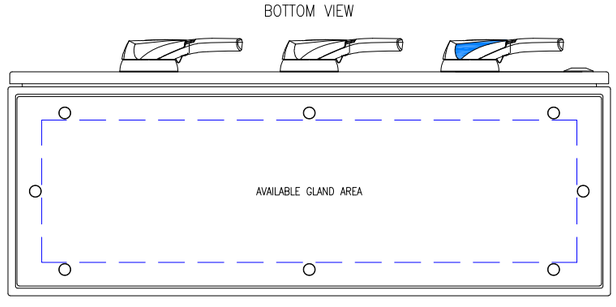

THIRD ANGLE PROJECTION
ALL DIMENSIONS IN mm UNLESS STATED

Scale:	Size:
Not To Scale	A3

Notes:

1. MAXIMUM CABLE LUG SIZE FOR MAINS INPUT AND LOAD OUTPUT TERMINALS = 95mm² (M10 LUG).
2. MAXIMUM CABLE SIZE FOR UPS INPUT AND UPS OUTPUT TERMINALS = 95mm² (M10 LUG) - M8 FOR NEUTRAL.
3. MAXIMUM CABLE SIZE FOR AUXILIARY CONTACTS = 4mm².
4. REMOVABLE GLANDS PLATES TOP AND BOTTOM.
5. PANEL COLOUR = RAL 7035.
6. DOOR SHOWN HINGED ON THE LEFT. CAN BE HINGED ON THE RIGHT ON REQUEST.

Rev	Date	Description	Dr'n / Ck'd
02	27/07/21	PANEL SIZE & BUS BAR	C.B / P.J
01	10/06/19	PANEL SIZE & BUS BAR	C.B / P.J
00	25/01/19	FIRST ISSUE	C.B / P.J

APS
Adept Power Solutions
Unit 1, Viscount Court
Walworth Industrial Estate, South Way
Andover, Hampshire. SP10 5NW
Tel: +44 (0) 1264 351217 Fax: +44 (0) 1264 351217

Project:
STANDARD PRODUCT

Drawing Title:
WALL MOUNTED UPS
EXTERNAL MAINTENANCE
BYPASS PANEL (TYPE 2)
THREE PHASE IN
THREE PHASE OUT
RATING - 250A

Drawn By:	Date:
C.B	25/01/2019
Checked By:	**Date:**
P.J	25/01/2019

Drawing Number:
APS-BP-0359-02

This document is confidential & the property of Adept Power Solutions.
Unauthorised reproduction or distribution is prohibited.
© 2019 APS